



*Thomas B. Thrige*  
Odense

Sk/Lu

## TEST-SHEET

Aktiebolaget Götaverken, Göteborg.

(M/S "Anna Knudsen")

Order No. 276635 19 49

Test date: 12/7-50

Armature No.: 9-19221

Enclosure: enclosed ventilated

Dimensions: 16x30

8 Brushes No.: KA19

Quality: EG70

compound motor

Type: CL 19

No: 3003868

Volts: 220

Amps: 151

R.P.M.: 500

HP, ~~KVA~~ 42

Rating: cont.

Insulation: Test voltage: 2000

volts for 1 min.

Resistance: 60 megohms.

Hour	Terminat Volts	Line Amps.	Shunt		R. P. M.	Air. temp. °C.	Remarks
			Volts	Amps.			
8.30	220	151	220	2,03	498	21,5	
9.30	"	"	"	1,88	510	22,0	
10.30	"	"	"	1,85	512	23,0	
11.30	"	"	"	1,83	"	"	
12.30	"	"	"	1,83	"	23,5	
13.30	"	"	"	"	515	23,5	
14.00	"	"	"	"	"	"	


Temperature rise:

Armature: 22,5 °C, Shunt: 21,5 °C,

Series-winding: 18,5 °C, Interpoles: 17,5 °C, Commutator: 17,5 °C

14.00	220	189	220	1,86	510	23,5	
15.00	"	"	"	1,84	515	23,0	
16.00	"	"	"	"	"	"	
	"	151	"	1,84	"	"	
	"	"	"	1,84	"	"	
	"	8	"	"	550	"	
	"	227	"	"	507	"	

for 1 min. Yes,

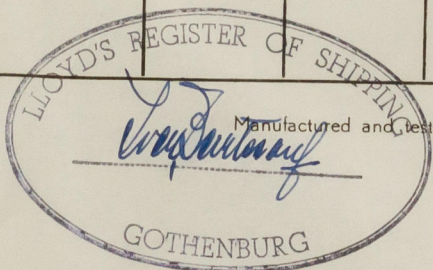

Manufactured and tested in accordance with

Rules of Lloyd's Register

Odense, Denmark

29/12-50

© 2020

pr. Thomas B. Thrige