
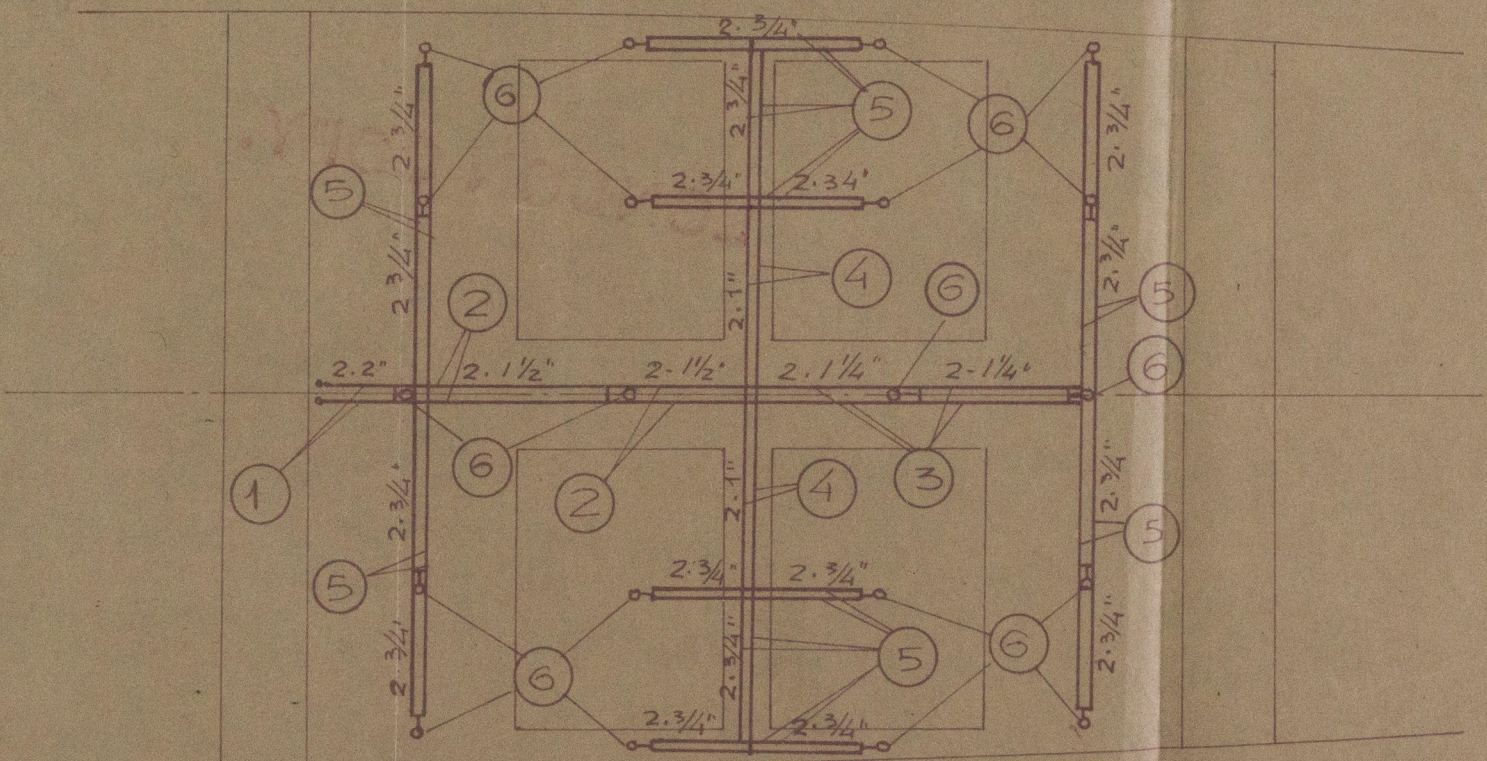


LONDON COPY.

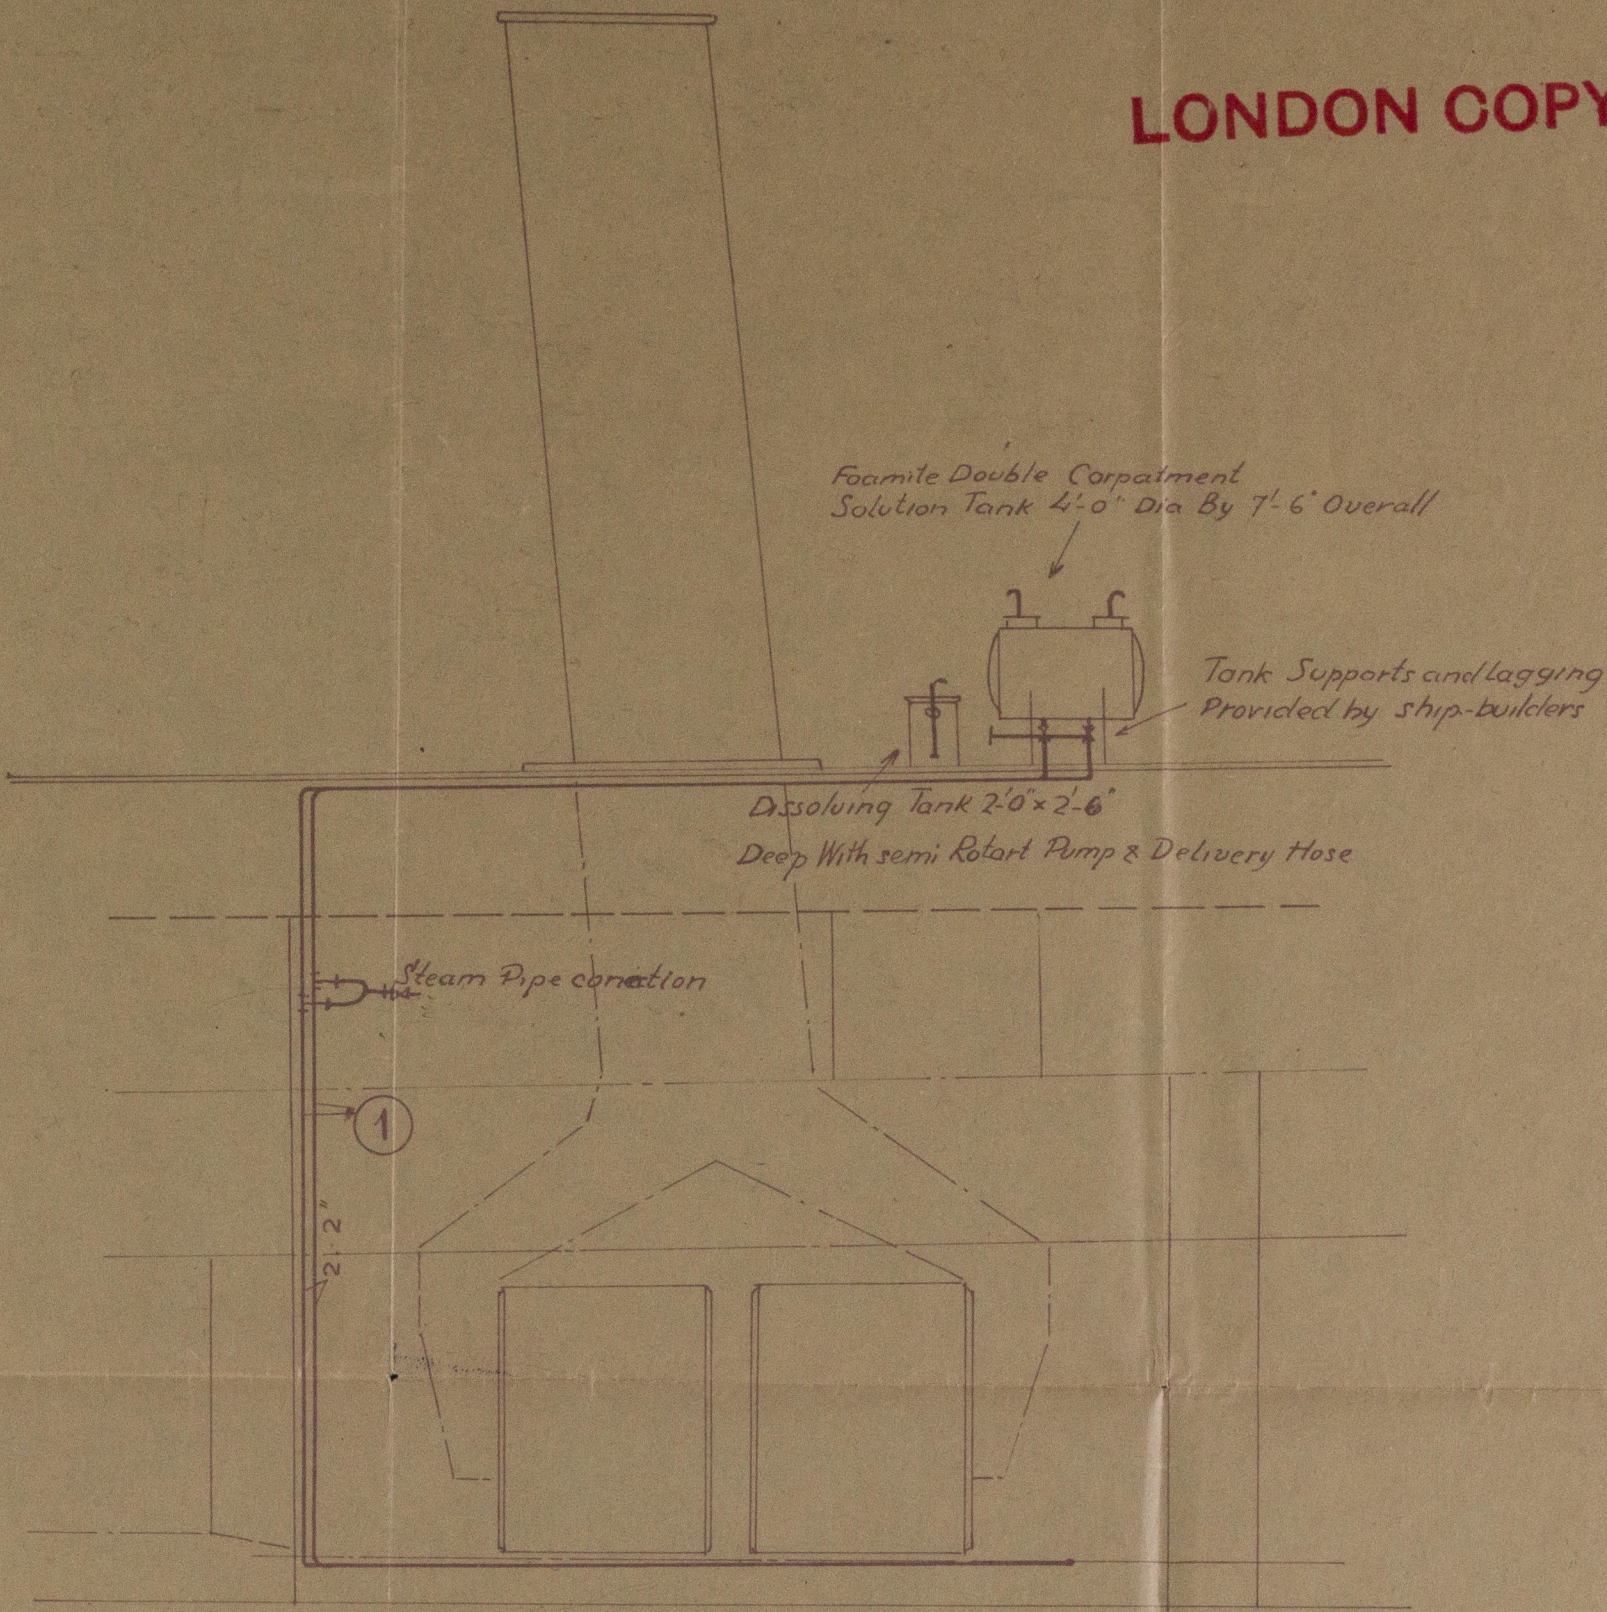

List of Pipe & Fittings

Nº	Discription	Bore	Length in m.
1	Pipe	2"	42
2	"	1 1/2"	12
3	"	1 1/4"	10
4	"	1"	10
5	"	3/4"	70
6	Foam Strayers	-	Peeces 20

W.G.F.
22-11-35.

S/S Kumanovo

Pr. br.	Brodogradilište, Split, P.D.	11.35
	Spediše Split, Francuska Obala 2	
	Fire extinguishing Pipe arrangement for Boiler Room	On br. 164/1
Mjerilo: 1:96	Pr. br.	Wzpa br. IV-3


W248-0187

SP Kumanova

Split ref.

No. 492.

LONDON COPY.



© 2019

Lloyd's Register

W248F0187 Foundation