Auxiliary Generator ...	2 per pole						excluding equalizer	
Emergency Generator ...	2	·5	61	·103	318	50		"
Rotary Transformer... ...								"

Barrow Rpt. No 1945

W985-0014

Nº 575
T.S.S. JERVIS BAY.
ELECTRICAL MAIN DISTRIBUTION. DIAGRAM.

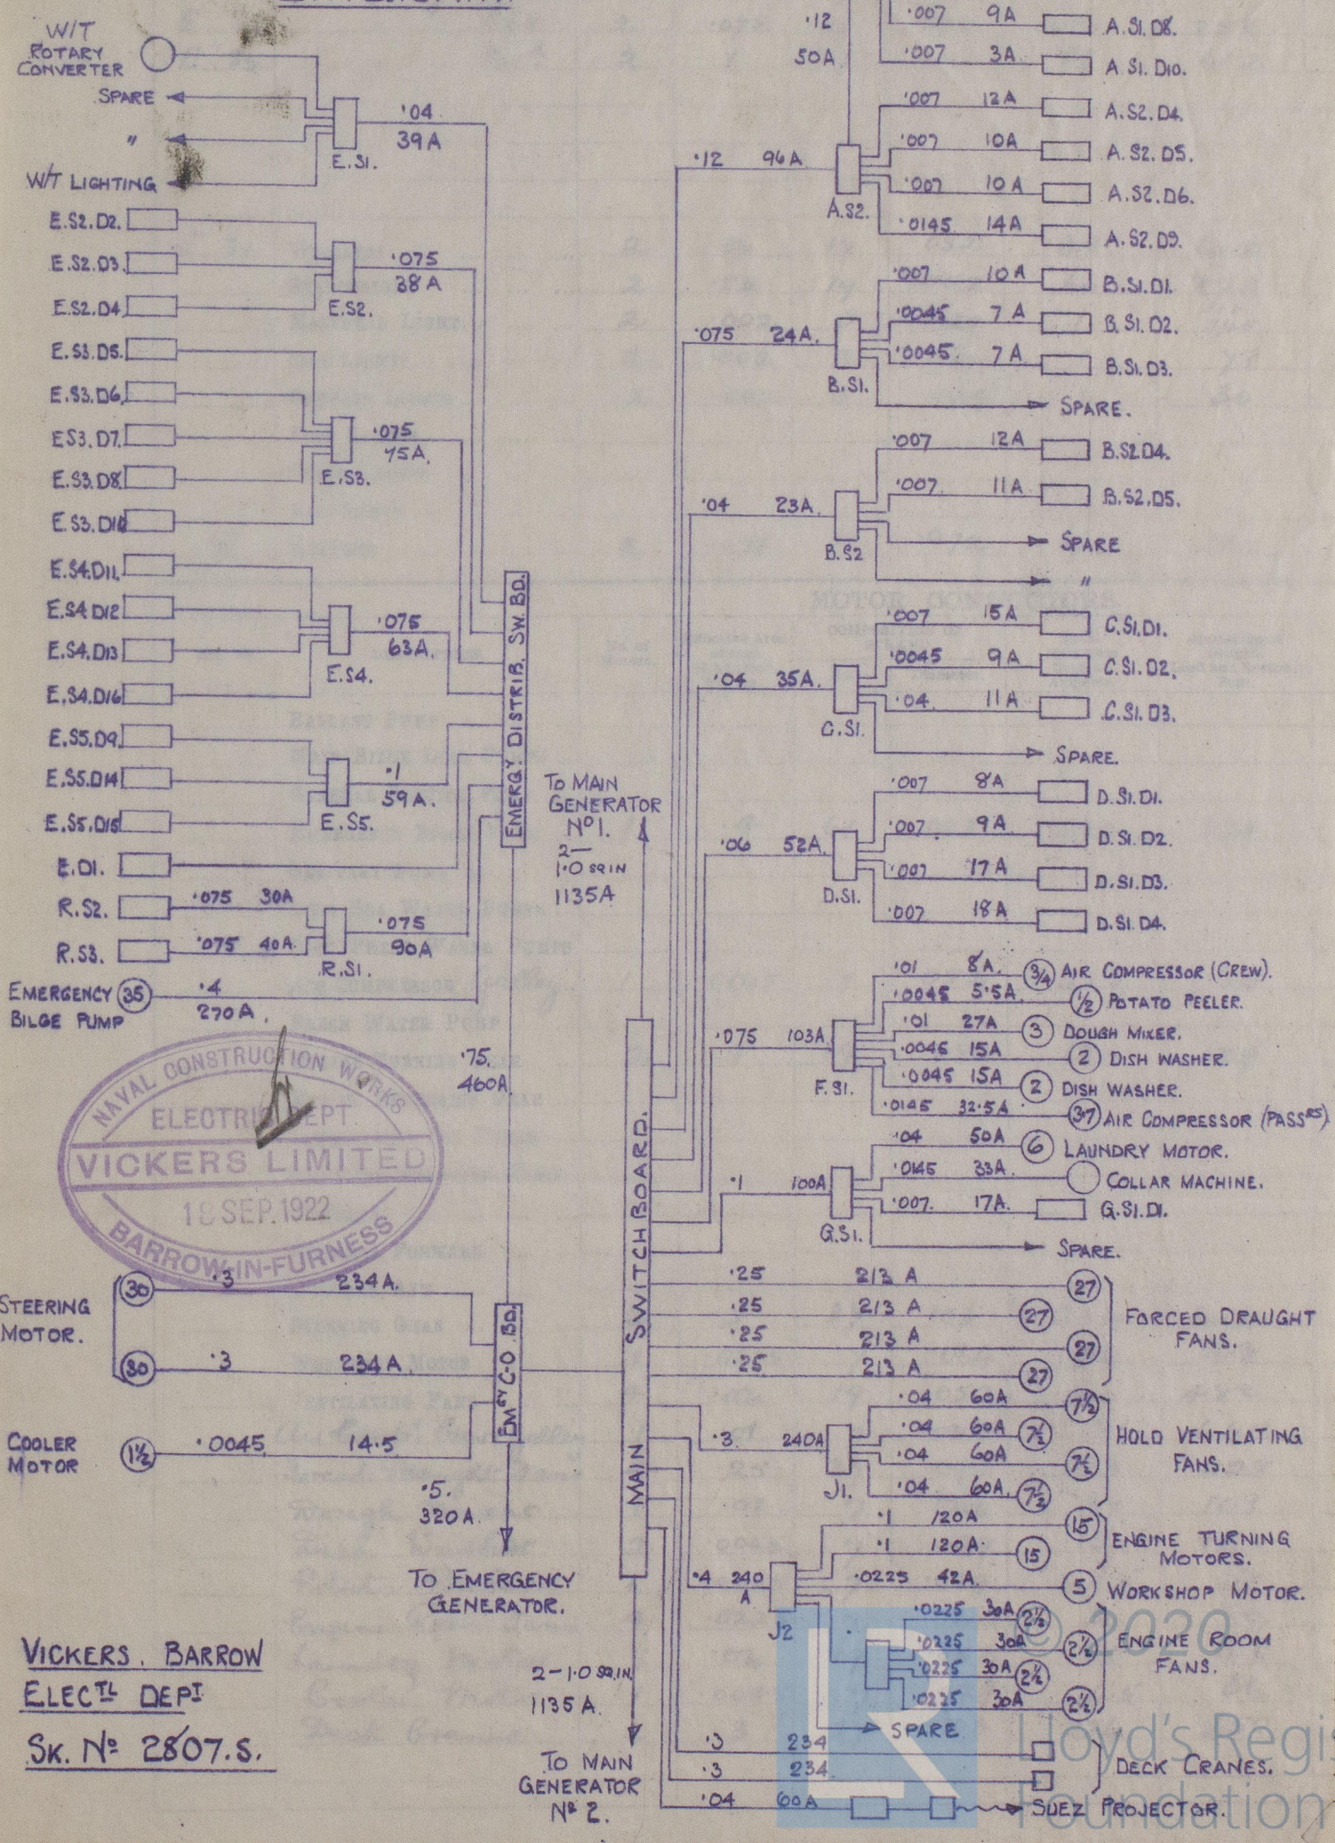

NAVAL CONSTRUCTION WORKS
ELECTRICAL DEPT.
VICKERS LIMITED
18 SEP. 1922
BARROW-IN-FURNESS

VICKERS. BARROW
ELECTL DEPT
SK. Nº 2807.S.

V.I.R.

V.I.R.

Insulated with

V.I.R.

V.I.R.

V.I.R.

V.I.R.

© 2020 Lloyd's Register Foundation